


SECTION @ TENANT SEPARATION WALL (1 hr.) DESIGN U419

3/4"=1'-Ø"

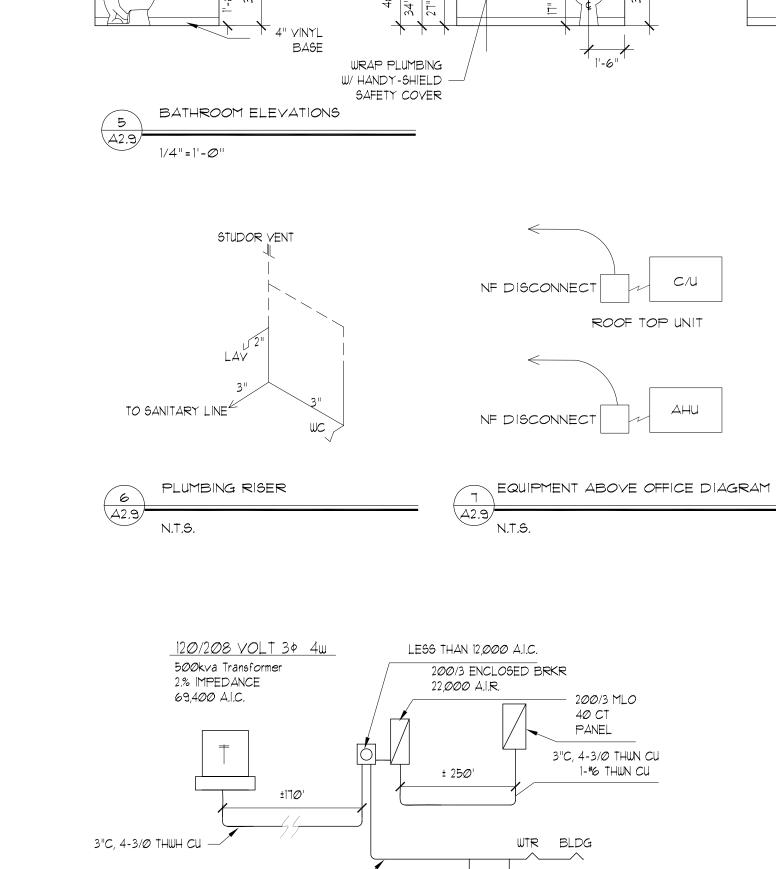

ELECTRICAL RISER DIAGRAM

EPOXY PAINTED

- GYPSUM BOARD

TYPICAL

1½"Φ x 42"

TOILET PAPER

DISPENSER

MIRROR

S.S. GRAB BAR

FIRE RESISTANCE RATINGS - ANSI/UL263 (BXUV) - Continued Design No. U419
Non Bearing Wall Rating - 1, 2, 3 or 4 Hr (See Items 3 & 4)

1. *Floor and Ceiling Runners* - Channel shaped, fabricated from min 25 MSG corrosion-protected steel, min width to accommodate stud size, with min 1 in. long legs, attached to floor and ceiling with fasteners 24 in. OC max.

2. **Steel Studs** - Channel shaped, fabricated from min 25 MSG corrosion - protected steel, min width as indicated under Item 4, min 1-1/4 in. flanges and $\frac{1}{4}$ in. return, spaced a max of 24 in. OC. Studs to be cut 3/8 to $\frac{3}{4}$ in. less than assembly height.

3. **Batts and Blankets*** - (Required as indicated under Item 4) - Mineral wool batts, friction fitted between studs and runners. Min nom thickness as indicated under Item 4. See Batts and Blankets (BKNV or BZJZ) Categories for names of Classified companies.

3A. Batts and Blankets* - Placed in stud cavities, any glass fiber or mineral wool insulation bearing the UL Classification Marking as to Surface Burning Characteristics and/or Fire Resistance. See Batts and Blankets (BKNV or BZJZ) Categories for names of Classified companies.

4. *Wallboard, Gypsum** - Gypsum panels with beveled, square or tapered edges, applied vertically or horizontally. Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Vertical joints in adjacent layers (multilayer systems) staggered one stud cavity. Horizontal edge joints and horizontal butt joints on opposite side of studs staggered a min of 12 in. Horizontal edge joints and horizontal butt joints in adjacent layers (multilayer systems) staggered a min of 12 in. The thickness and number of layers for the 1 hr, 2 hr, 3 hr and 4 hr ratings are as follows:

Wallboard Protection on Each side of Wall

11/2" x 36" PAPER TOWEL

5.5. GRAB BAR DISPENSER -

- 5/8" × 8'-0" CU RODS

Rating	Min. Stud	Gyp. Thkns.	Insulatio
1 1	3-1/2 2-1/2	1 layer, ⁵ ⁄8" 1 layer, ½"	Optional 1-1/2"
2	1-5/8	2 layers, ½"	Optiona
2 2	1-5/8 3-1/2	2 layers, ⁵ / ₈ " 1 layer, ³ / ₄ "	Optional 3"
3	1-5/8	3 layers, ½"	Optiona
3	1-5/8	2 layers, ¾"	Optiona
4	1-5/8	4 layers, ½"	Optiona
4	2-1/2	2 layers, ¾"	2"

Canadian Gypsum Co. - ½ in. thick Type C, WRC or IP-X2; 5/8 in. thick Type SCX, SHX, WRX, IP-X1, AR, C, WRC or IP-X2; ¾ in. thick ULTRACODE or Type IP-X3
United States Gypsum Co. - ½ in. thick Type C, WRC or IP-X2; 5/8

in. thick Type SCX, SHX, WRX, IP-X1, AR, C, WRC or IP-X2; ¾ in. thick ULTRACODE or Type IP-X3

Yeso Panamericano SA de CV - ½ in. thick Type C, WRC or IP-X2; 5/8 in. thick Type SCX, SHX, WRX, IP-X1, AR, C, WRC or IP-X2; ¾ in. thick ULTRACODE or Type IP-X3.

5. Fasteners - Type S or S-12 self-drilling, self-tapping steel screws used to attach panels to studs (Item 2) or furring channels (Item 6). Single layer systems: 1 in. long for ½ and 5/8 in. thick panels or 1-1/4 in. long for ¾ in. thick panels, spaced 8 in. OC when panels are applied horizontally, or 12 in. OC when panels are applied vertically. Two layer systems: First layer - 1 in. long for ½ and 5/8 in. thick panels or 1-1/4 in. long for ¾ in. thick panels, spaced 16 in. OC. Second layer- 1-5/8 in. long for ½ in. thick panels or 2-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC with screws offset 8 in. from first layer. Three-layer systems: First layer- 1 in. long for ½ in. thick panels, spaced 24 in. OC Second layer - 1-5/8 in. long ½ in. thick panels, spaced 24 in. OC. Third layer - 2 - 1/4 in. long 1/2 in. thick panels, spaced 12 in. OC. Screws offset min 6 in. from layer below. Four-layer systems: First layer - 1 in. long for ½ in. thick panels, spaced 24 in, OC, Second layer - 1-5/8 in, long for ½ in, thick panels. spaced 24 in. OC. Third layer - 2 -1/4 in. long for ½ in. thick panels, spaced 24 in. OC. Fourth layer - 2 - 5/8 in. long for ½ in. thick panels, spaced 12 in OC. Screws offset min 6 in. from layer below.

6. *Furring Channels* - (Optional, not shown, for single or double layer systems) - Resilient furring channels fabricated from min 25 MSG corrosion-protected steel, spaced vertically a max of 24 in. OC. Flange portion attached to each intersecting stud with 1/2 in. long Type S-12 panhead steel screws.

7. **Joint Tape and Compound** - Vinyl or casein, dry or premixed joint compound applied in two coats to joints and screw heads of outer layers. Paper tape, nom 2 in. wide, embedded in first layer of compound over all joints of outer panels.

8. **Siding, Brick or Stucco** - Aluminum, vinyl or steel siding, brick veneer or stucco, meeting the requirements of local code agencies, installed over gypsum panels. Brick veneer attached to studs with corrugated metal wall ties attached to each stud with steel screws, not more than each sixth course of brick.

9. Caulking and Sealants* - A bead of acoustical sealant applied around the partition perimeter for sound control.
 United States Gypsum Co. - Type AS
 *Bearing the UL Classification Marking

PERMIT SET

June 30, 2005

Boyington

ARCHITECTS. INC.

110 South Kentucky Avenue
Lakeland, Florida 33801
Phone 863 687-3573
Fax 863 683-6370

Fax 863 683-6370
Web wmbarchs.com
Email mail@wmbarchs.com
Corp. Lic. No. AAC001165

3115 DRANE FIELD ROAD
PECIAL DISTRIBUTION (BAYS 20, 21,
FOR THE RUTHVENS
LAKELAND, FLORIDA

DR. BY: KDH

CHKD. BY: JMM

DATE: 6/30/05

SCALE: AS NOTED

PROJ. NO.: 9913

DWG. No.:

A2.9
sht: - of: -